

Laboratory Acoustical Test Report

FC22-0553

Impact Insulation Class and Sound Transmission Class

ASTM E492, E90

November 8, 2022

Test Assembly:

SPC Urban Surfaces SoundTec SPC Flooring

Urban Surfaces FloorSilencer Boost

5000 PSI Concrete Slab


IIC-57

HIIC-71

LIIC-75


STC-56

Impact Insulation Class Test FC22-0523: IIC 57

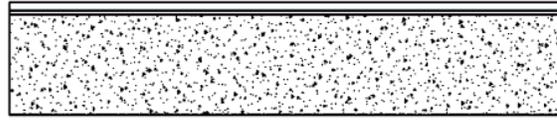

Finish Flooring Acoustical Fiberboard Assembly Type	6 mm Urban Surfaces SoundTec SPC Flooring 6 mm Urban Surfaces FloorSilencer Boost 203.2 mm 5000 PSI Concrete Slab
---	---


Test Date:	September 18, 2022	
Construction Date:	September 18, 2022	
Test Specimen Area:	11	sq.m.
Receiving Room Volume:	158	cu.m.
Receiving Room Temperature:	21.5-21.5	degrees C
Receiving Room Relative Humidity:	66-66	percent

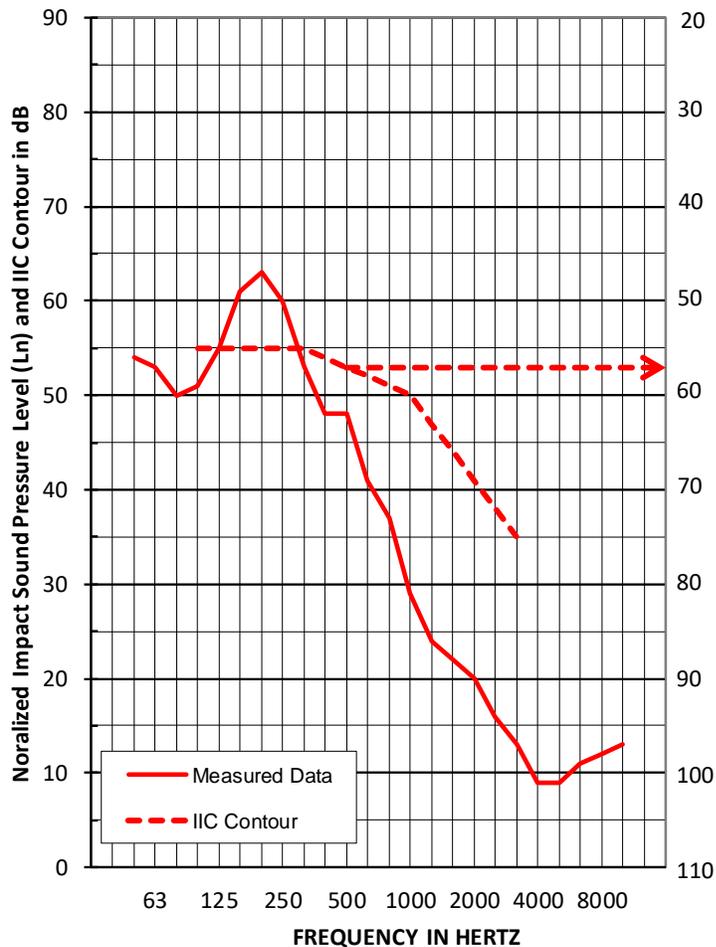

95% Confidence		
Freq	Limit	Ln
50	1.5	54
63	2.9	53
80	2.0	50
100	1.5	51
125	1.7	55
160	1.4	61
200	0.7	63
250	1.0	60
315	0.8	53
400	0.8	48
500	0.6	48
630	0.5	41
800	0.5	37
1000	0.6	29
1250	0.4	24
1600	0.4	22
2000	0.6	20
2500	0.6	<u>16</u>
3150	0.4	<u>13</u>
4000	0.3	<u>9</u>
5000	0.4	<u>9</u>
6300	0.5	<u>11</u>
8000	0.5	<u>12</u>
10000	0.6	<u>13</u>


Background Affected

High-frequency Impact Insulation Class Test FC22-0523: HIIC 71



Finish Flooring Acoustical Fiberboard Assembly Type	6 mm Urban Surfaces SoundTec SPC Flooring 6 mm Urban Surfaces FloorSilencer Boost 203.2 mm 5000 PSI Concrete Slab
---	---


Test Date:	September 18, 2022	
Construction Date:	September 18, 2022	
Test Specimen Area:	11	sq.m.
Receiving Room Volume:	158	cu.m.
Receiving Room Temperature:	21.5-21.5	degrees C
Receiving Room Relative Humidity:	66-66	percent

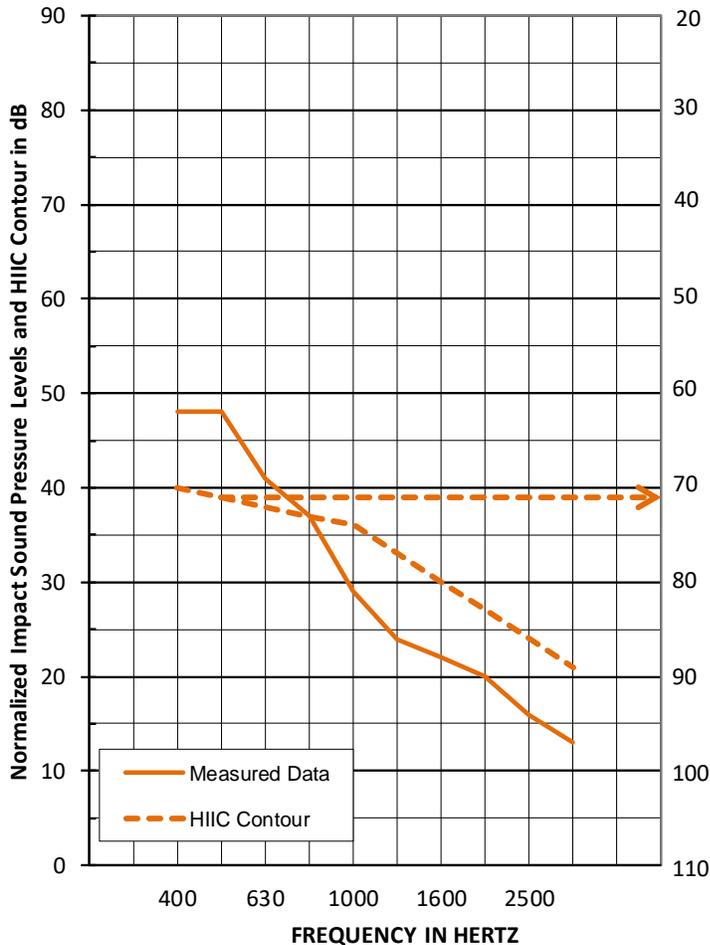

95% Confidence		
Freq	Limit	Ln
400	0.8	48
500	0.6	48
630	0.5	41
800	0.5	37
1000	0.6	29
1250	0.4	24
1600	0.4	22
2000	0.6	20
2500	0.6	<u>16</u>
3150	0.4	<u>13</u>


Background Affected

Sound Transmission Class Test FC22-0523: STC 56



Finish Flooring Acoustical Fiberboard Assembly Type	6 mm Urban Surfaces SoundTec SPC Flooring 6 mm Urban Surfaces FloorSilencer Boost 203.2 mm 5000 PSI Concrete Slab
---	---

Test Date: September 18, 2022
 Construction Date: September 18, 2022
 Test Specimen Area: 11 sq.m.
 Source/Receiving Room Volume: 190/158 cu.m.
 Source/Receiving Room Temperature: 21.5/19.8 degrees C
 Source/Receiving Room Relative Humidity: 66/66 percent

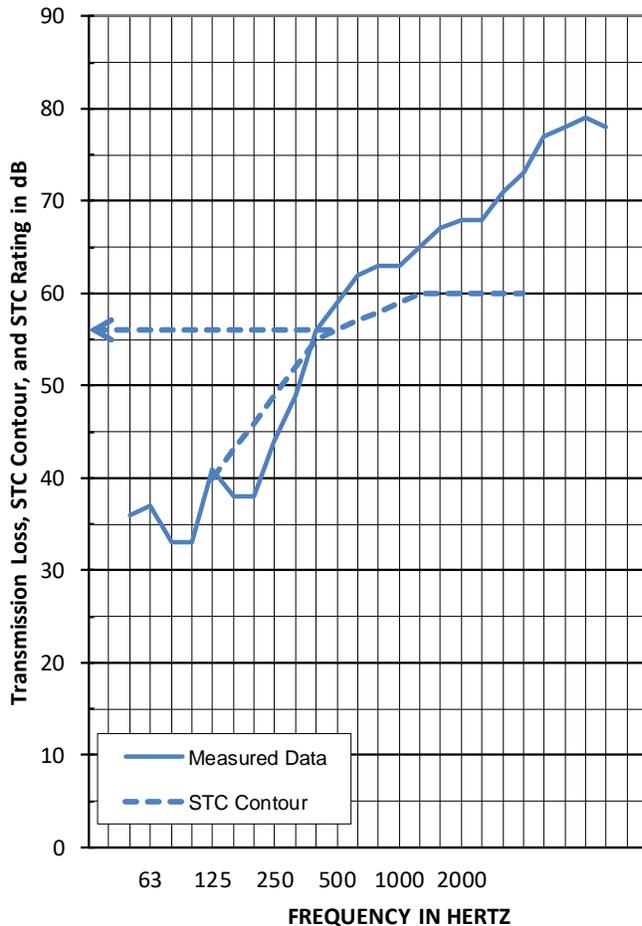

Freq	TL
50	36
63	37
80	33
100	33
125	41
160	38
200	38
250	44
315	49
400	56
500	59
630	62
800	63
1000	63
1250	65
1600	67
2000	68
2500	68
3150	71
4000	73
5000	77
6300	<u>78</u>
8000	<u>79</u>
10000	<u>78</u>

Background Affected
 Flanking Affected
Background and Flanking Affected

1.0 TEST PROCEDURES

1.1 Impact Insulation Tests

All tests were conducted in accordance with ASTM E492, "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine." The IIC is a single-number rating derived from the Impact Sound Pressure Level in accordance with ASTM E989, "Standard Classification for Determination of Impact Insulation Class (IIC)." Results are presented above.

95% confidence intervals represent uncertainty for microphone averaging, not tapping positions.

1.2 High-frequency Impact Insulation Class Tests

The HIIC is the High-frequency Impact Insulation Class and is meant to assess the high-frequency impact noise on a floor-ceiling assembly. The higher the value, the better the floor, meaning less noise from high-frequency impacts in the space below.

All tests were conducted in accordance with the requirements of ASTM E492, "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine," using ASTM E3222 "Standard Classification for Determination of High-frequency Impact Sound Ratings" to calculate the High-frequency Impact Insulation Class (HIIC). Results are presented above.

1.3 Low-frequency Impact Insulation Class Tests

The LIIC is the Low-frequency Impact Insulation Class and is meant to assess the low-frequency impact noise on a floor-ceiling assembly. The higher the value, the better the floor, meaning less noise from low-frequency impacts in the space below.

All tests were conducted in accordance with the requirements of ASTM E492, "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine," using ASTM E3207 "Standard Classification for Determination of Low-frequency Impact Noise Ratings" to calculate the Low-frequency Impact Insulation Class (LIIC).

Measured result is LIIC-75.

1.4 Transmission Loss Tests

All tests were conducted in accordance with ASTM E90, "Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions," using the single-direction method. STC is a single-number rating derived from measured values of Sound Transmission Loss through a test specimen in accordance with ASTM E413, "Classification for Rating Sound Insulation." Results are presented above.

2.0 TEST ASSEMBLY

2.1 Assembly Description

The test assembly consists of:

- Urban Surfaces SoundTec SPC Flooring, Finish Flooring;
- Urban Surfaces FloorSilencer Boost, Acoustical Fiberboard;
- 5000 PSI Concrete Slab, Concrete Slab;

Total mass of the floor-ceiling assembly was 5892.7 kg, having an area density of 536.68 kg/m²).

Product/Element	Thickness	Dimensions	Area	Area Density
Urban Surfaces SoundTec	6 mm	1219 mm x 178 mm	10.98 m ²	9.41 kg/m ²
Urban Surfaces FloorSilencer Boost	6 mm	908 mm x 597 mm	10.98 m ²	2.56 kg/m ²
Concrete Slab	203.2 mm	3023 mm x 3632 mm	10.98 m ²	524.71 kg/m ²

2.2 Installation

The materials were installed in the following manner:

- Urban Surfaces SoundTec SPC Flooring: Loose laid
- Acoustical Fiberboard: Loose laid
- Concrete Slab: Installed in a test frame flush to the source room. Mats of #5 reinforcing bars were placed 25.4 mm from both the top and bottom of the slab, with bars spaced on 305 mm centers in both directions. No noticeable shrinkage or cracking was visible on the specimen.

The assembly was constructed on September 18, 2022.

3.0 TESTING PROTOCOL

This report summarizes laboratory acoustical testing contracted by Veneklasen to be completed for Veneklasen Associates on 6.0 mm Urban Surfaces SoundTec SPC Flooring over 6.0 mm Urban Surfaces FloorSilencer Boost Acoustical Fiberboard. The scope of the acoustical testing is for Impact Insulation Class (IIC), High-frequency Impact Insulation Class (HIIC), Low-frequency Impact Insulation Class (LIIC), and Sound Transmission Class (STC), in accordance with ASTM standards E492, E90.

The tests were conducted on September 18, 2022. Details of the tests are contained in this report. Testing was completed in strict accordance with the following standards:

- ASTM E90, "Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions"
- ASTM E413, "Classification for Rating Sound Insulation"
- ASTM E492, "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine"
- ASTM E989, "Standard Classification for Determination of Impact Insulation Class (IIC)"
- ASTM E2235, "Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods"
- ASTM E3207, "Standard Classification for Determination of Low-frequency Impact Noise Ratings."
- ASTM E3222, "Standard Classification for Determination of High-frequency Impact Sound Ratings."

3.1 Equipment

Equipment list and information associated with this test, including calibration information, is included in the Appendix.

3.2 Accreditation and Reporting

Report must be distributed in its entirety except with written authorization from Veneklasen Associates. Test was conducted at IAS-accredited test facility; the full report is available upon request. Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available on request.

Veneklasen Associates provides no warranties, expressed or implied, regarding the structural integrity or fitness of these assemblies for a specific installation. Any advertising which utilizes this test report or test data must not imply product certification or endorsement by Veneklasen Associates, NVLAP, NIST or the U.S. Government.

Sincerely,
Veneklasen Associates, Inc.



John LoVerde, FASA
Principal

APPENDIX

Test Equipment and Photos

Instrument	Manufacturer	Model	Description	Serial Number	Calibration Date
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02586	04/22
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02587	04/22
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02608	04/22
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02609	04/22
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02610	04/22
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02612	04/22
Microphone Calibrator	Norsonic	34093	Acoustical Calibrator	65105	10/21
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	06/22
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63740	04/22
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	64340	10/21
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63744	09/21
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	65968	01/22
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810 63811	10/21 10/21
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65103	02/22
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	64902	12/21
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63739	07/22
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63742	04/22
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	64906	04/22
Source room environmental indicator	Comet	T7510	Temperature and humidity transmitter	63812	10/21
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	02/22
Test Chamber Receive Room Volume			158.34 m ³ (5591.89 ft ³)		
Test Chamber Source Room Volume			190 m ³ (6709.79 ft ³)		

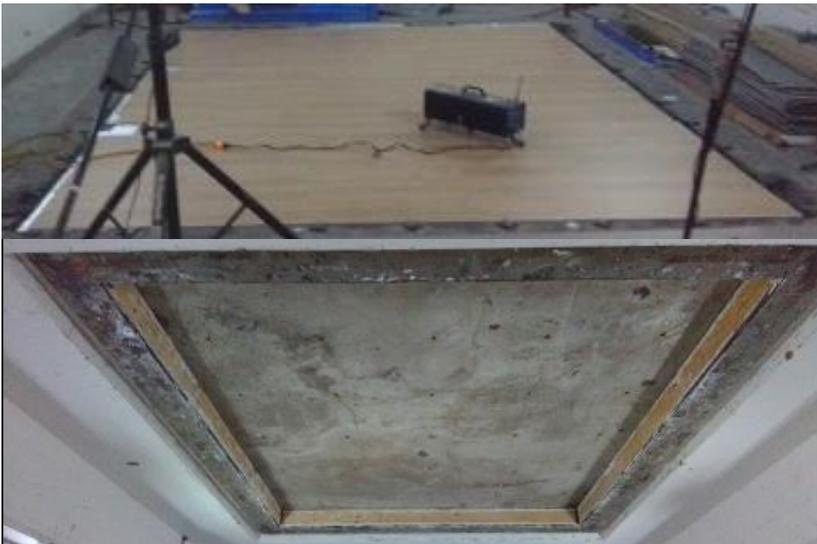


Photo 1: View of Source Chamber, finish flooring installation observed

Photo 2: View of Receive Chamber, bottom of ceiling observed